



Air capacity (NI/s) at different vacuum levels (-Kpa)

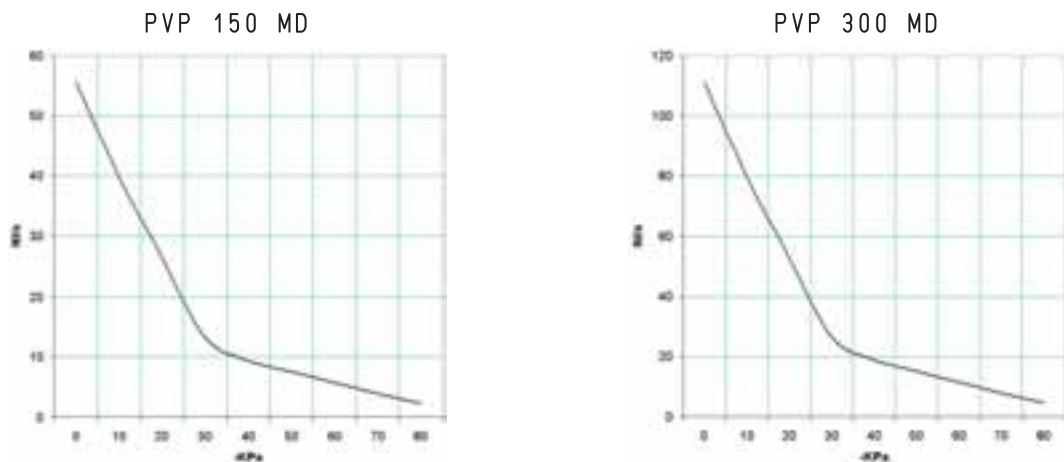

Generator art.	Supply press. bar (g)	Air consumption NI/s	Air capacity (NI/s) at different vacuum levels (-KPa)										Max. vacuum level -KPa
			0	10	20	30	40	50	60	70	80		
PVP 150 MD	6.0	16	55.55	39.68	26.45	13.22	9.44	7.55	5.68	3.97	2.27	90	
PVP 300 MD	6.0	32	111.11	79.36	52.91	26.45	19.89	15.11	11.36	7.94	4.54	90	

Evacuation time (ms/l=s/m³) at different vacuum levels (-Kpa)

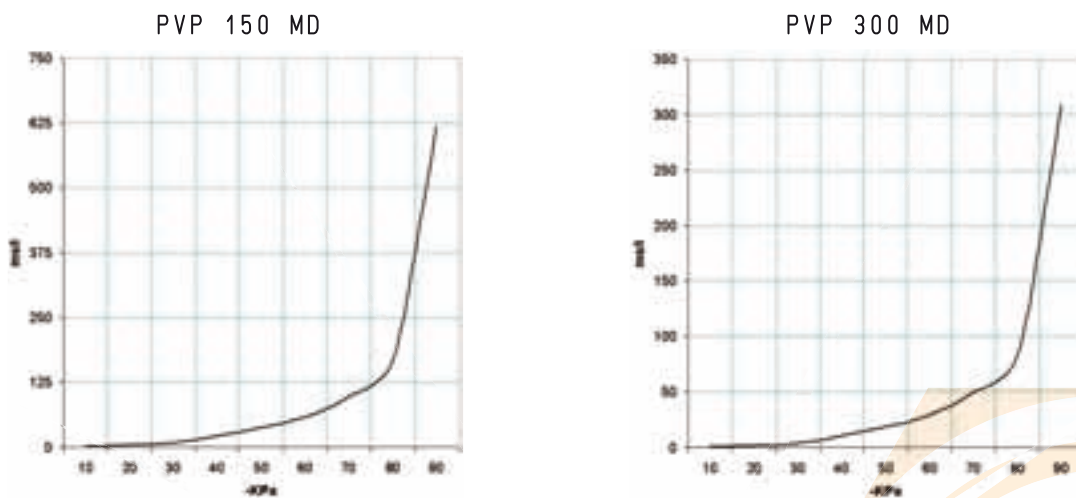

Generator art.	Supply press. bar (g)	Air consumption NI/s	Evacuation time (ms/l = s/m³) at different vacuum levels (-KPa)										Max. vacuum level -KPa
			10	20	30	40	50	60	70	80	90		
PVP 150 MD	6.0	16	1.6	4.0	8.9	21.3	38.2	58.4	97.0	167.8	618	90	
PVP 300 MD	6.0	32	0.8	2.0	4.4	10.6	19.1	29.2	48.5	83.9	386	90	