



VACUUM REGULATORS

3D drawings are available on vuototecnica.net

These devices control the level of vacuum, maintaining it constant at the pre-set value (secondary vacuum), regardless of the network's flow rate and the fluctuations in vacuum level (primary vacuum).

They operate by membrane-piston and exploit the pressure differential between the secondary vacuum and the atmospheric pressure.

Unlike the vacuum control valves, reducers do not release air into the circuit, thereby allowing for the creation more grip points taken at different degrees of vacuum, from a single vacuum source.


The level of vacuum is adjusted manually by turning the knurled thumb screw clockwise to increase it, and counter clockwise to decrease it.

Technical features

- Operation: membrane-piston regulator.
- Adjustable operating pressure: from 800 to 1 mbar abs.
- Flow rate : from 2 to 160 m³/h.
- Room temperature: from -10 to +80 °C.
- Installation position: any.

Usage

The best use of vacuum reducers is in centralised plants where, regardless of the plant's level of vacuum, each outlet can be adjusted within that value. Moreover, they are necessary whenever the working vacuum must be lower than the primary vacuum.

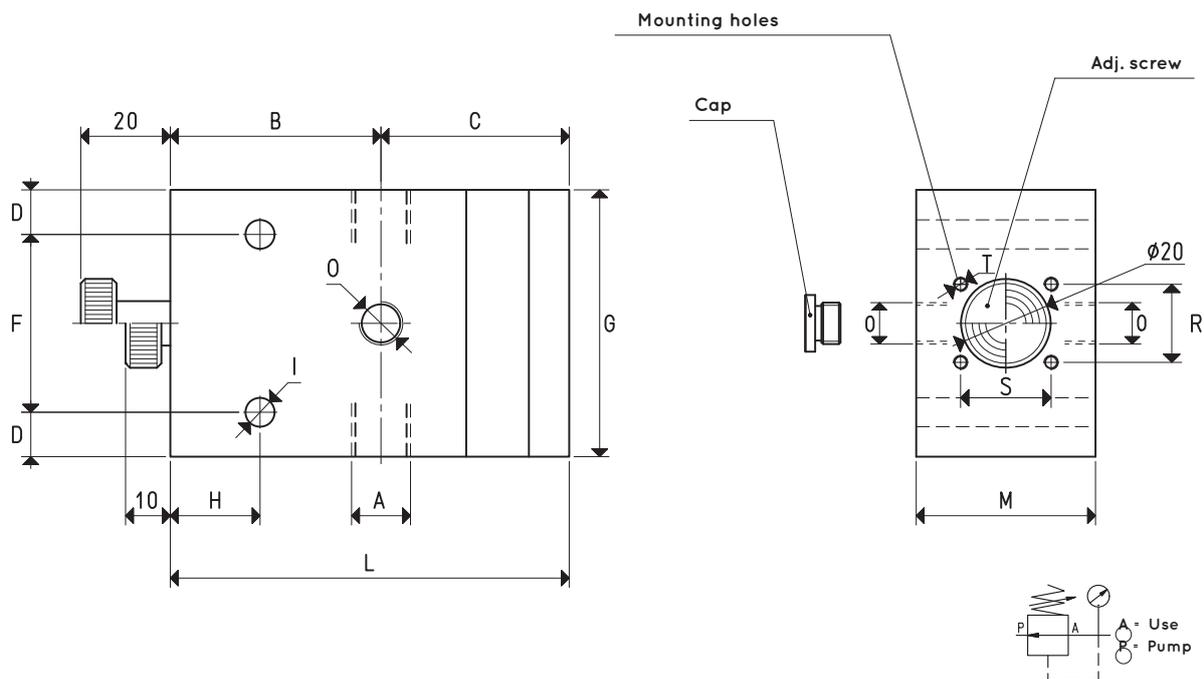

Item	A Ø	Max capac. m ³ /h	B	C	D	F	G	H	I Ø	L	M	O Ø	R	S	T	Weight Kg
11 01 10	G1/4"	6	47	42.0	10	40	60	20	6.5	89.0	40	G1/8"	28	24	M4	0.60
11 02 10	G3/8"	10	47	42.0	10	40	60	20	6.5	89.0	40	G1/8"	28	24	M4	0.58
11 03 10	G1/2"	20	53	52.0	15	55	85	25	8.5	105.0	50	G1/4"	38	34	M4	1.15
11 04 10	G3/4"	40	55	55.5	15	70	100	30	8.5	110.5	50	G1/4"	38	34	M5	1.39
11 05 10	G1"	80	60	58.0	15	90	120	30	8.5	118.0	60	G1/4"	38	34	M5	2.08
11 06 10	G1" 1/2	160	54	77.5	15	130	160	20	8.5	131.5	99	G1/4"	50	50	M6	5.49

Accessories and Parts		11 01 10	11 02 10	11 03 10	11 04 10	11 05 10	11 06 10
Sealing kit	item	00 11 113	00 11 114	00 11 115	00 11 116	00 11 117	00 11 118
Vacuum gauge	item	09 03 15	09 03 15	09 03 10	09 03 10	09 03 10	09 03 10
Vacuum switch	item	12 40 10	12 40 10	12 40 10	12 40 10	12 40 10	12 40 10

Note: The vacuum gauges and vacuum switches are not integral parts of the regulators and, therefore, must be ordered separately.

Transformation ratio: N (newton) = Kg x 9.81 (force of gravity) inch = $\frac{\text{mm}}{25.4}$; pounds = $\frac{\text{g}}{453.6} = \frac{\text{Kg}}{0.4536}$ Adapters for GAS - NPT threading available on page 1.134